

Wet Slip Test Certificate

Friday March 29th, 2019

Supplier: Floors Distributors Pty Ltd (P.O. Box 197, Neutral Bay Junction, NSW, 2098)


Sample Description: Urban Laminate with Triton Protect Engineered Floor Board

Date Tested: March 2019 (Tested through FORAY Laboratories - NATA Accreditation 1231)

Test Method: AS/NZS 4586-2013 Appendix A "Slip resistance classification of new pedestrian surface materials – Wet Pendulum Test Method" using a Four S slider (Slider 96)

Test Data:

| Sample Identification | Wet Pendulum Slip resistance result ¹ | Classification ² (Standards Australia AS/NZS 4586:2013) |
|-----------------------------------------------------------|--------------------------------------------------|-----------------------------------------------------------------------|
| Urban Laminate with Triton Protect Engineered Floor Board | 36 | P3 |

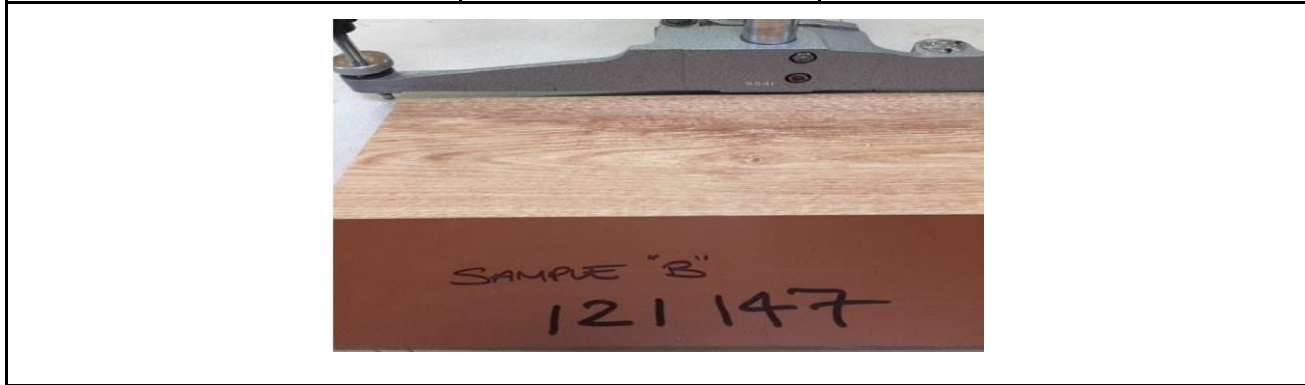

¹ Five test average value

² The classifications indicate that the contribution of the floor surfaces to the risk of slipping when wet is moderate.



Dr. Vyt Garnys
PhD, BSc(Hons) AIMM, ARACI, ISIAQ
ACA, AIRAH, FMA
Managing Director and Principal Consultant



Nick Joy
BSc(Hons)
Consultant



Tuan Duong
B. Eng. (Chemical)
Consultant

CV190386